

**DIVISION V
DESIGN CRITERIA**

SECTION 5200 STREETS

Approved and Adopted this 17th day of April, 1996

Kansas City Metropolitan Chapter
of the American Public Works Association

Table of Contents

Section	Title	Page No.
5201	GENERAL	
5201.1	Introduction	52-1
5201.2	Definitions	52-1
5201.3	Abbreviations	52-1
5201.4	Governing Specifications	52-2
5202	FUNCTIONAL CLASSIFICATION OF STREETS	
5202.1	Major Arterial Streets	52-2
5202.2	Minor Arterial Streets	52-2
5202.3	Industrial/Commercial Collector	52-2
5202.4	Residential Collector Streets	52-2
5202.5	Residential Local Streets	52-2
5202.6	Residential Access Streets	52-2
5203	GENERAL STREET DESIGN CRITERIA	
5203.1	Design Criteria	52-2
5203.2	Maximum and Minimum Gradient	52-6
5203.3	Shoulder Gradients	52-6
5203.4	Tangent Length	52-6
5203.5	Off-Center Street Intersections	52-6
5203.6	Intersection Angle	52-6
5203.7	Intersecting Minor/Major Arterial Streets	52-6
5203.8	Curb Radii	52-6
5203.9	Sight Distance At Intersecting Streets	52-6
5203.10	Considerations For Connection to Existing and Future Streets	52-6
5203.11	Pavement Section	52-6
5203.12	Pavement Transition	52-6
5203.13	Cul-De-Sacs	52-6
5203.14	Temporary Turn-Arounds	52-7
5203.15	Driveway Grades	52-7
5203.16	Access for the Disabled	52-7
5203.17	Street Lighting	52-7
5203.18	Storm Drainage	52-7
5203.19	Underdrains	52-7
5203.20	Erosion Control Within R/W Limits	52-7
5203.21	Survey Monument Boxes	52-7
5203.22	Traffic Impact Studies	52-7
5203.23	Obstructions	52-7
5203.24	Other Design Criteria	52-7

5204	GENERAL PLAN REQUIREMENTS	
5204.1	Scope	52-8
5204.2	General	52-8
5204.3	Scales	52-8
5204.4	Sheet Sizes	52-8
5204.5	Types of Sheets in Plans	52-8
5204.6	Required Information for Title Sheet	52-9
5204.7	Required Information for General Layout Sheet	52-9
5204.8	Required Information for Planed and Profile Sheets	52-9
5204.9	Required Information for Cross-Section Sheets	52-10
5204.10	Required Information for Standard and Special Detail Sheets	52-11
5204.11	Required Information for Lighting Plans	52-11
5204.12	Required Information for Traffic Control Plan Sheets	52-11
5204.13	Required Information for Temp. Erosion Control Plan Sheets	52-11
5205	FIGURES	
	FIGURE 1 - Design Controls for Sag Vertical Curves	52-12
	FIGURE 2 - Design Controls for Crest Vertical Curves	52-13
	FIGURE 3 - Off-Center Street Intersections	52-14
	FIGURE 4 - Typical Residential Street Layout	52-15
	FIGURE SMB - Survey Monument Box	52-16
5206	TABLES	
	TABLE 1 - Street Pavement Types	52-17

**DIVISION V
DESIGN CRITERIA**

SECTION 5200 STREETS

SECTION 5201 GENERAL

5201.1 Introduction: The purpose of this criteria is to provide uniform procedures for designing and checking the design of streets in the Kansas City Metropolitan area. Specific criteria have been developed and are applicable to the types of conditions ordinarily encountered in local urban and suburban areas. Other special situations may be encountered that require added criteria or more complex design than included herein.

In addition to this criteria, street improvements shall be designed to conform to applicable codes, regulations, and ordinances as established by the local governing agency. Streets shall be designed in accordance with the classifications determined by the local governing agencies and shall conform to APWA Standard Drawing Typical Sections, unless otherwise approved. Plans for said improvements shall be submitted to the local governing agency for approval and shall include all information as may be required or described hereinafter.

5201.2 Definitions:

- A. City Engineer:** The term City Engineer, as used in this criteria, shall represent the state, county, city, or other governmental body's representative responsible for technical decisions concerning the project. Such person may be the Director of Public Works, City or County Engineer, Administrator or any other person empowered by the governing agency to make such decisions.
- B. Engineer:** The term Engineer, as used in this criteria, shall represent the Engineer or Designer who performs the actual design work. The design shall be accomplished under the direction of a Registered Professional Engineer. Nothing in this criteria is intended to alter or circumvent local, state, or federal laws or regulations regarding liability and/or responsibility for such designs.

5201.3 Abbreviations:

AASHTO	American Association of State Highway and Transportation Officials
ADT	Average Daily Traffic
APWA	American Public Works Association
ASTM	American Society for Testing and Materials
FHWA	U.S. Department of Transportation/Federal Highway Administration
MUTCD	Manual of Uniform Traffic Control Devices
NGVD	National Geodetic Vertical Datum
ITE	Institute of Transportation Engineers
R/W	Right-of-Way

5201.4 Governing Specifications: Design shall be in accordance with the latest edition of the following specifications and the current interim supplements thereto except as modified herein or modified for the specific project:

- A. A Policy on Geometric Designs of Highways and Streets, AASHTO.
- B. Manual on Uniform Traffic Control Devices for Streets and Highways, FHWA.
- C. Roadside Design Guide, AASHTO.
- D. Design of Pavement Structures, AASHTO.

SECTION 5202 FUNCTIONAL CLASSIFICATION OF STREETS:

5202.1 Major Arterial Streets (or Primary Arterial, or Urban Principal Arterial): Streets that serve the highest traffic volume corridors and the longest trip. Provides travel between business districts and outlying residential areas, between major inner city communities and between major suburban centers, and connects communities to major state and interstate highways. No or limited access is allowed from residential streets. Access is usually partially controlled. Spacing of major arterial streets is generally from one mile to five miles.

5202.2 Minor Arterial Streets (or Secondary Arterial, or Urban Minor Arterial): Streets that interconnect and augment the major arterial streets. No or limited access is allowed from residential lots. Accommodate trips of moderate length at a lower level of travel mobility than major arterial streets. Spacing of minor arterial streets is generally from one-half mile to three miles.

5202.3 Industrial/Commercial Collector (or Collector, or Urban Collector): Streets that collect traffic to and from commercial or industrial areas and distribute it to arterial streets.

5202.4 Residential Collector Streets (or Collector, or Urban Collector): Streets that collect traffic to and from residential areas and distribute it to arterial streets. Limited access is allowed from residential lots. Desirable maximum ADT = 3,000 for residential collector streets.

5202.5 Residential Local Streets (or Local, or Urban Local): Streets that only carry traffic having its origin or destination within the immediate neighborhood. Desirable maximum ADT = 1,000 for local streets. (ADT = ten trips per day per typical single-family residence.)

5202.6 Residential Access Streets: Streets that carry traffic between residential lots and residential local streets or residential collector streets. Residential access streets usually carry no through traffic and include short loop streets, cul-de-sacs, and courts. Desirable maximum ADT = 200 for cul-de-sacs and 400 for loop streets. Maximum length of cul-de-sacs = 500 feet and 1,000 feet for loop streets. (ADT = ten trips per day per typical single-family residence.)

SECTION 5203 GENERAL STREET DESIGN CRITERIA:

5203.1 Design Criteria: This section governs the general design requirements for the following street classifications (see notes on page 52-4):

	Major Arterial	Minor Arterial	Industrial/ Commercial Collector	Residential⁽⁴⁾ Collector	Residential⁽⁴⁾ Local	Residential⁽⁴⁾ Access
Number of Through Traffic Lanes⁽²⁾	4-6	3-4	2-4	3	2	2
Minimum Width of Traffic Lanes (Excluding curb & gutter)	12 ft	12 ft	12 ft	11 ft	12 ft	10.5 ft - 12 ft
No. of Parking Lanes	0-2	0-2	-0-	0-2	0-2	0-1
Width of Parking Lanes	8 ft	8 ft	-0-	8 ft	8 ft	8 ft
Width of Median	16 ft	0 ft - 16 ft	-0-	-0-	-0-	-0-
Min. R/W Width⁽⁵⁾	100 ft-150 ft	80 ft	60 ft-80 ft	60 ft	50 ft (2) 45 ft (1)	40 ft
Min. Design Speed mph⁽⁶⁾	50	40	35	30	25	20
Minimum Stopping Sight Distance	400 ft-475 ft	275 ft-325 ft	225 ft-250 ft	200 ft	150 ft	125 ft
Min. K Crest Vert. Curve⁽³⁾	110-160	60-80	40-50	30	20	10
Min. K Sag Vert. Curve⁽³⁾	90-110 (55 w/lighting)	60-70 (35 w/lighting)	50 (27 w/lighting)	40 (20 w/lighting)	30 (14 w/lighting)	20 (9 w/lighting)
Min. Radii Hor. Curves⁽⁹⁾	1,091 ft (2% Superelevation)	700 ft	500 ft	300 ft	185 ft	100 ft
Min. Hor. Sight Distance	(Per AASHTO Requirements)					

	Major Arterial	Minor Arterial	Industrial/ Commercial Collector	Residential⁽⁴⁾ Collector	Residential⁽⁴⁾ Local	Residential⁽⁴⁾ Access
Sidewalks	2	2	2 Commercial 1 Industrial	2	1-2	0-1
Maximum Grade⁽⁶⁾	6%	7%	6%	8%	10%	12%
Minimum Grade⁽⁷⁾	1.0%	1.0%	1.0%	1.0%	1.0%	1.0%
Curb Return Radius	35 ft-50 ft	35 ft	30 ft Comm. 50 ft Indust.	25 ft 35 ft Desirable	20 ft 25 ft Desirable	20 ft 25 ft Desirable
Min. Distance from Intersection of R/W to Driveway Curb-cut	250 ft	200 ft	150 ft	100 ft	25 ft	25 ft
Intersection Sight Distance	(See Article 5203.9)					
Maximum Grade at Intersection w/stop	---	---	---	3% (within 75 ft)	5% (within 50 ft)	5% (within 25 ft)
Minimum Spacing of Similar Roadways	(See Section 5202)			1/4 mile	200 ft	175 ft

NOTES:

1. *At end of cul-de-sac, minimum design speed = 10 mph, with corresponding minimum horizontal radius = 25 ft, minimum stopping sight distance = 75 ft; minimum K Crest = 3, and minimum K Sag = 5 (2 w/lighting).*
2. *All street design is subject to local governing agency approval.*
3. *K values for crest and sag vertical curves may be determined using the chart on Figure 1 or 2, or in accordance with AASHTO - A Policy on Geometric Design of Highways and Streets. Figure III-41 and III-43. The upper range K value shown on page 52-3 shall be used unless otherwise approved by the local governing agency.*
4. *See Figure 4 for typical residential street layout.*
5. *Consideration should be given to providing a 15 ft minimum wide utility easement along each side of the right-of-way for residential access streets and 10 ft wide utility easements for all other streets.*

6. *Absolute maximum grade = 10% for residential collectors, 13% for residential local streets, and 15% for residential access streets.*
7. *Absolute minimum grade = 0.8% and should only be used for relatively short distances.*
8. *The 10.5 ft lane width for residential access streets shall only be used in a planned development where a minimum of four off-street parking spaces are provided for each dwelling unit.*
9. *30 mph design speed with corresponding horizontal and vertical curve design criteria may be used for industrial commercial collector streets under special conditions when approved by the City Engineer.*
10. *The minimum radii shown is based on the AASHTO design for low-speed urban streets with no superelevation except for major arterials. The minimum radii for major arterials is based on 2% superelevation.*

- 5203.2 Maximum and Minimum Gradient:** The maximum and minimum gradient for streets as noted in Section 5203.1 may be exceeded only upon written approval of the local governing agency.
- 5203.3 Shoulder Gradients:** The finished grade within the limits of the right-of-way shall slope from 2% one-quarter (1/4) inch vertical to one (1) foot horizontal minimum, to 4% one-half (1/2) inch vertical to one (1) foot horizontal maximum measured above the back of the curb. The grading gradients may be varied only upon written approval of the local governing agency. Back slopes beyond the R/W line shall be 3:1 maximum, 4:1 desirable.
- 5203.4 Tangent Length:** No tangent length shall be required between reverse curves for residential access and local streets. The minimum tangent length between reverse curves shall be 100 feet for collector/industrial streets. Major and minor arterial streets shall comply with current AASHTO guidelines.
- 5203.5 Off-Center Street Intersections:** Off-center street intersections shall be separated as shown on Figure 3(M).
- 5203.6 Intersection Angle:** It is desirable for all intersections to meet at approximately a 90° angle. Skewed intersections should be avoided and in no case should the angle be less than 75°.
- 5203.7 Intersecting Minor/Major Arterial Streets:** Where any minor or major arterial streets intersect each other, the crowns of both streets shall be uniformly transitioned into a plane at the intersection unless otherwise approved. Changes from one cross slope to another should be gradual.
- 5203.8 Curb Radii:** When two streets of different classification intersect, the higher classification street shall govern the curb radii dimension listed in 5203.1. Equivalent three-center compound curves may be used in lieu of a single radius curve. Curb ends facing the flow of traffic shall have a five-foot taper from full height to zero.
- 5203.9 Sight Distance at Intersecting Streets:** Sight distance triangles at intersecting side streets shall be in accordance with the current edition of A Policy on Geometric Design of Highways and Streets, AASHTO. Every effort shall be made to select intersection locations so that the maximum sight distance is possible.
- 5203.10 Considerations For Connection to Existing and Future Streets:** Consideration shall be given to the horizontal and vertical alignment of roadways where they connect to existing streets or where roadways may be extended in the future. Where a new street is to connect to an existing street, all deteriorated or cracked asphalt within five feet of the connection point shall be removed to a point where sound material is found. Existing pavement is to be saw cut for the entire width of the street to a minimum depth of six inches. If full-depth pavement removal is required, the subgrade shall be re-compacted to 95% of standard density.
- 5203.11 Pavement Section:** Pavement shall be constructed upon compacted subgrade and of materials and the minimum thickness as shown on the standard drawings for the applicable street classification.
- 5203.12 Pavement Transition:** Reduction in pavement width in the direction of traffic flow shall be accomplished by a taper. The minimum desirable length for merging taper shall be determined by the formula $L = WS^2/60$ where posted speeds are 45 mph or less. The formula $L = W \times S$ should be used for roadways having a posted speed limit greater than 45 mph. Under either formula, L = taper length in feet, W = width of the closed lane in feet, and S = design speed, in mph.
- 5203.13 Cul-De-Sacs:** At locations where streets are to be terminated and a vehicular connection between adjacent streets is not required, the termination shall be a cul-de-sac. Such cul-de-sac shall be

constructed with a minimum radius of 39 feet to the back of the curb if there are no islands located in the cul-de-sac.

5203.14 Temporary Turn-Arounds: At locations where streets will be temporarily terminated and which will be extended at a later date, and said street extends beyond the intersection of an adjacent street more than 150 feet, a temporary cul-de-sac shall be constructed with a minimum radius of thirty-five (35) feet. The temporary cul-de-sac shall be constructed of asphaltic concrete with a minimum depth of eight inches. Curb and gutter will not be required. The cul-de-sac shall be constructed within the limits of a temporary easement.

Temporary Turn-Arounds shall be located so that they do not interfere with permanent development. They should normally be located on property adjacent to the property to be served. For new subdivision plats, they should be located on property beyond the limits of the plat.

5203.15 Driveway Grades: Driveway grades shall conform to the typical section of the street within the right of way. Any deviations shall be approved by the local government official with the following limitations: Driveways shall attain a minimum elevation of six inches above the gutter elevation within the right of way with a maximum grade of 8%. The algebraic difference in grades at the right-of-way on crest drives shall be 8% maximum and on sag drives shall be 12% maximum. The maximum driveway grade outside the right-of-way shall be 15%.

5203.16 Access for the Disabled: Ramps shall be required at all planned sidewalk-curb intersections in accordance with standard practice and approved by the local governing agency. Non-standard driveways and alleys will also be designed to accommodate the handicapped.

5203.17 Street Lighting: All street lighting shall be designed in accordance with Section 5800 of the APWA design criteria unless otherwise directed or approved by the local governing agency.

5203.18 Storm Drainage: All storm drainage shall be designed in accordance with Section 5600 of the APWA design criteria unless otherwise directed or approved by the local governing agency.

5203.19 Underdrains: In areas that have known subsurface moisture problems, underdrains or drainage blankets shall be designed.

5203.20 Erosion Control Within R/W Limits: As a minimum, all grass areas in the R/W shall be seeded and mulched to control erosion on to the roadway. All construction projects that have exposed grading require temporary erosion control measures. Temporary erosion control must be approved by the City Engineer.

5203.21 Survey Monument Boxes: Monument boxes conforming to Figure 5 shall be installed at all quarter section corners involved in the street construction. The monument boxes shall be set by a Registered Land Surveyor licensed in the state the monumentation work is performed.

5203.22 Traffic Impact Studies: Required where developments have adverse impact on existing traffic conditions.

5203.23 Obstructions: Rigid structures such as poles and hydrants shall be placed a minimum horizontal distance of 1.5 feet from the face of curb to edge of obstruction. When required, guardrail and barricades shall be installed in accordance with the AASHTO Roadside Design Guide or local policies. Vertical clearance of a minimum 14.5 feet shall be provided. Along sidewalks, a minimum vertical clearance of seven feet shall be provided.

5203.24 Other Design Criteria: Design criteria not covered by this document shall be in accordance with the most current edition of A Policy on Geometric Design of Highways and Streets by the American

5204.6 Required Information for Title Sheet:

1. Name of project.
2. Project number (where applicable).
3. Index of sheets included in plans.
4. A location map adequately showing project location in relation to major streets. with north arrow and scale.
5. Signature block for local governing agency approval.
6. The project control bench marks shall be identified as to location and elevation: NGVD datum or as required by the local governing agency. A minimum of two (2) bench marks are required for any project.
7. Name, address and telephone number of the consulting engineer and owner/developer as well as signature block for the owner/developer.
8. List containing name and telephone number of each utility company and the State One-Call System.
9. A legend of symbols shall be shown that shall apply to all sheets.
10. Design speed plus other traffic information as required by the local governing agency.
11. Engineer's seal, signed and dated.

5204.7 Required Information for General Layout Sheet:

1. General Notes: Minor construction notes shall appear on the proper plan and profile sheet.
2. North arrow and bar scale. Scale of the general layout map shall be one (1) inch equals one hundred (100) feet.
3. Layout shall include name of subdivision, block designation if any, lot designation or proposed block and lots, all street names, street alignment with back of curb lines, and an accurate tie to at least one quarter section corner. An unplatted tract shall have an accurate tie to at least two (2) quarter section corners.
4. Boundary line of project area.
5. Schematic layout of all proposed sidewalks and utility improvements including storm drainage, sanitary sewers, water lines, street lights, traffic signals, etc., shall be shown.
6. A list of materials and quantities if not provided on a separate sheet.
7. Typical street sections and curb and gutter details.

5204.8 Required Information for Plan and Profile Sheets:

1. North arrows and bar scale.

2. Elevation and location of all applicable benchmarks; NGVD datum or as required by the local governing agency.
3. Existing and proposed streets with names and pavement widths.
4. Property lines properly identified as to existing or proposed lot, block and subdivision. Survey base line with adequate ties to land lines.
5. All existing and proposed utilities such as power, gas, oil, water, telephone, sewer, and other items shall be properly located in conformance with the best information available in the records of the owner of such facilities, or field location, and identified as to size and material.
6. All existing and known proposed improvements within 50 feet each side of right-of-way and 200 feet beyond the project limits shall be shown at their proper locations unless otherwise approved or required by the local governing agency. This shall include such existing items as paved streets, curb and gutters, driveways, culverts, fire hydrants, utility poles, trees, shrubs, fences, walls, houses, and other such items, and shall be identified as to type, size, material, etc. as may be applicable.
7. All existing and proposed easements and right-of-way information.
8. Locations and widths of existing and proposed sidewalks.
9. Horizontal curve data and vertical curve data (K value, stopping sight distance, and middle ordinate).
10. Center line stations shall be marked at 100-foot intervals and at other pertinent points.
11. Top of curb elevations shall be shown at maximum increments of 15 feet along the curb returns at street intersections.
12. Profile shall show existing grade as a dashed line, proposed finish grades or established street grades by solid lines.
13. Storm sewer criteria shall be in accordance with Section V.
14. Elevations shall be shown at a minimum interval of 50 feet for tangents and 25 feet for curves.
15. Approximate grading limits.
16. Location of test borings if taken.

5204.9 Required Information for Cross-Section Sheets:

1. Street cross section at each station showing existing grade by dashed lines and proposed grade by a solid line. Cross sections to show existing grade lines a minimum of ten (10) feet beyond right-of-way lines or grading limit, whichever is further. The center line and location right-of-way shall be shown.
2. Center line elevation of top of pavement.
3. Center line cross sections shall be shown at all intersecting streets and driveways.
4. Additional cross sections shall be shown as required to clearly describe the extent of the grading operations.

5. In lieu of cross sections for residential development, three or five line profiles may be used if approved by the local governing agency. The three line profiles shall consist of a profile of the existing ground at each right-of-way line and existing and finished profile at the center line of the street. The other two profiles shall show the final grade at the building setback line. A grading plan may be required for residential development.

5204.10 Required Information for Standard and Special Detail Sheets: Detail sheets shall be included to show all details of appurtenances, materials, and construction. Details shall conform to the requirements of the local governing agency and are to be drawn clearly and neatly with proper identifications, dimensions, materials and other information necessary to insure the desired construction.

5204.11 Required Information for Lighting Plans: Street lighting plans shall be prepared in accordance with Section 5800 of the APWA design criteria and included in addition to the street improvement plans for approval. The plan shall be at 1 inch = 50 feet (minimum) scale with the streets and adjacent plats labeled.


5204.12 Required Information for Traffic Control Plan Sheets:

1. Limits of any road closures shall be shown along with the traffic control devices used to effect the closure. Length of time of road closure shall be indicated.
2. Detour plan shall be designed for traffic affected by road closures. Detour signing used to direct motorist over the detour route shall be included in the detour plan.
3. Typical lane closure or lane shift plans including taper lengths and spacing of all channelizer devices. Types and spacing of all construction signs shall be shown.
4. All traffic control shall be designed using the traffic control devices and application principles contained in the MUTCD.

5204.13 Required Information for Temporary Erosion Control Plan Sheets:

1. Each temporary erosion control feature designation shall be shown at its proper location on the plans.
2. Temporary erosion control devices details as required, such as standard temporary beams, temporary slope drains, types of ditch checks, and sediment basins.


SECTION 5205 FIGURES

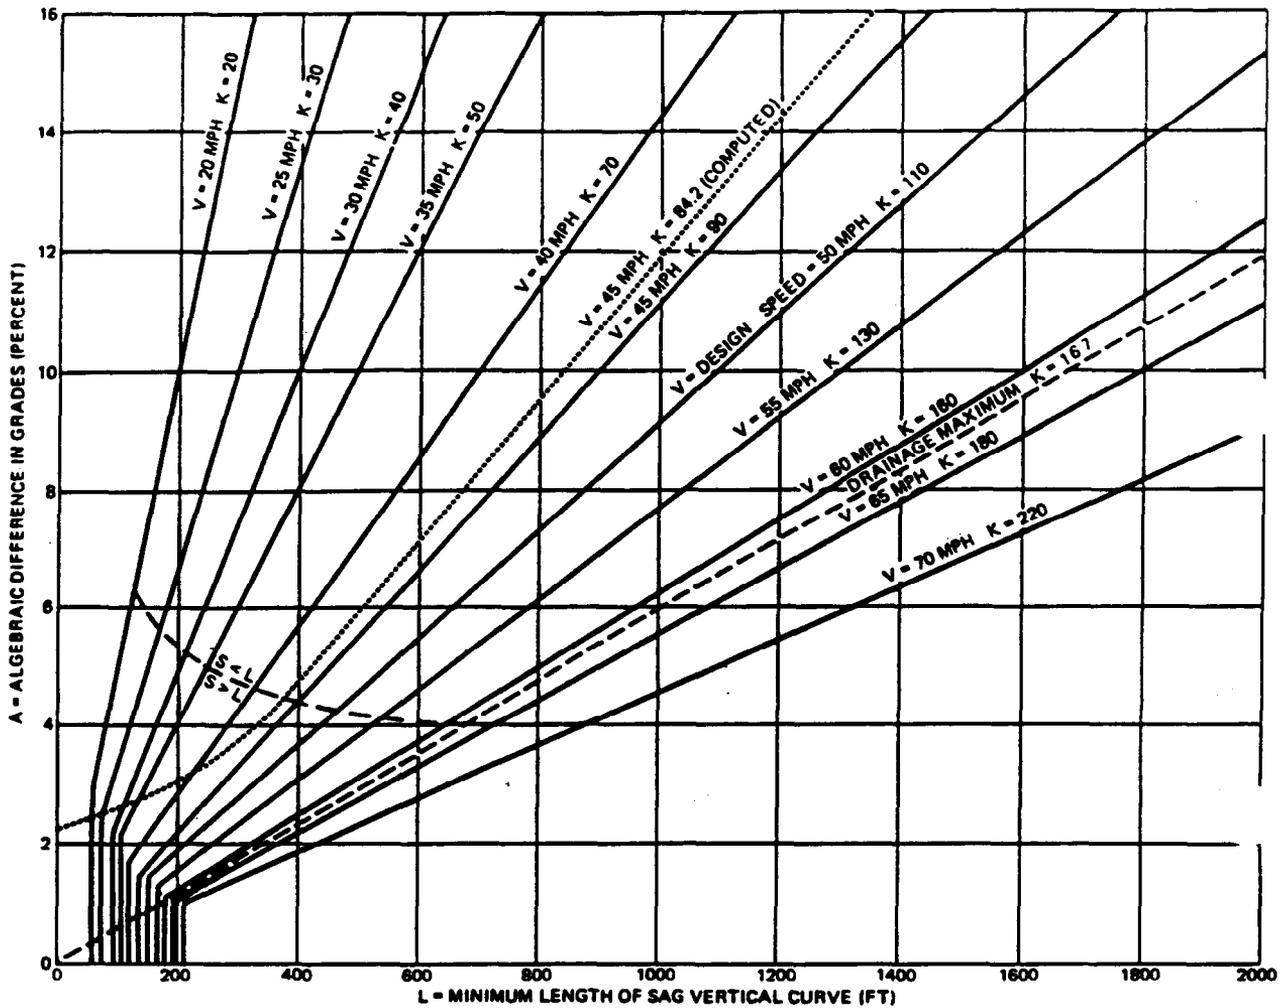

**DESIGN CONTROLS FOR SAG VERTICAL CURVES
OPEN ROAD CONDITIONS
UPPER RANGE**

Source: 1990 AASHTO
A Policy on Geometric Design of Highways and Streets




FIGURE 1

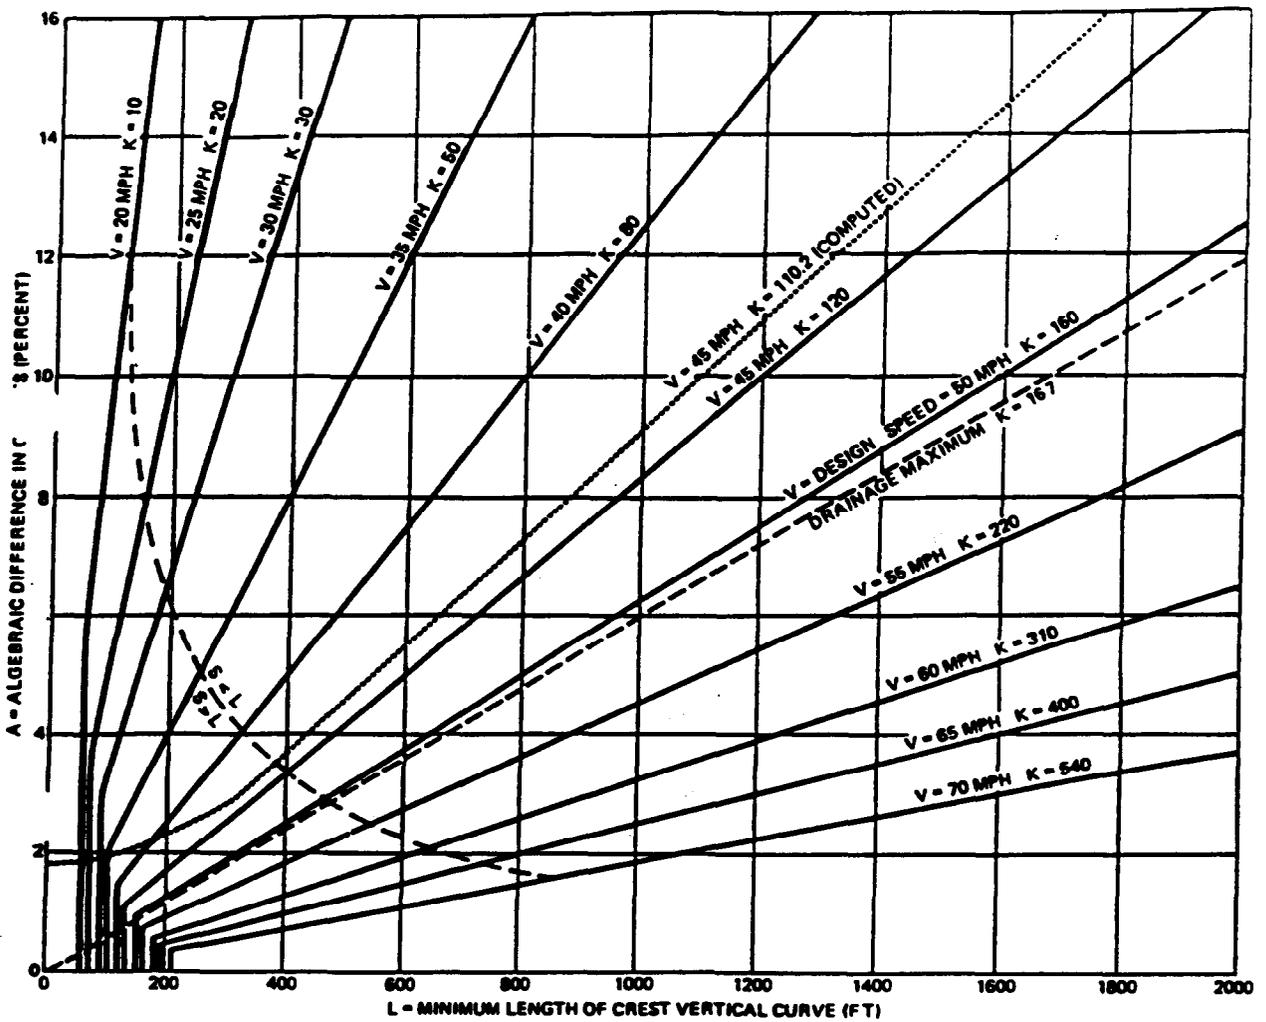

**DESIGN CONTROLS FOR CREST VERTICAL CURVES
FOR STOPPING SIGHT DISTANCE AND OPEN ROAD CONDITIONS
UPPER RANGE**

Source: 1990 AASHTO
A Policy on Geometric Design of Highways and Streets

FIGURE 2

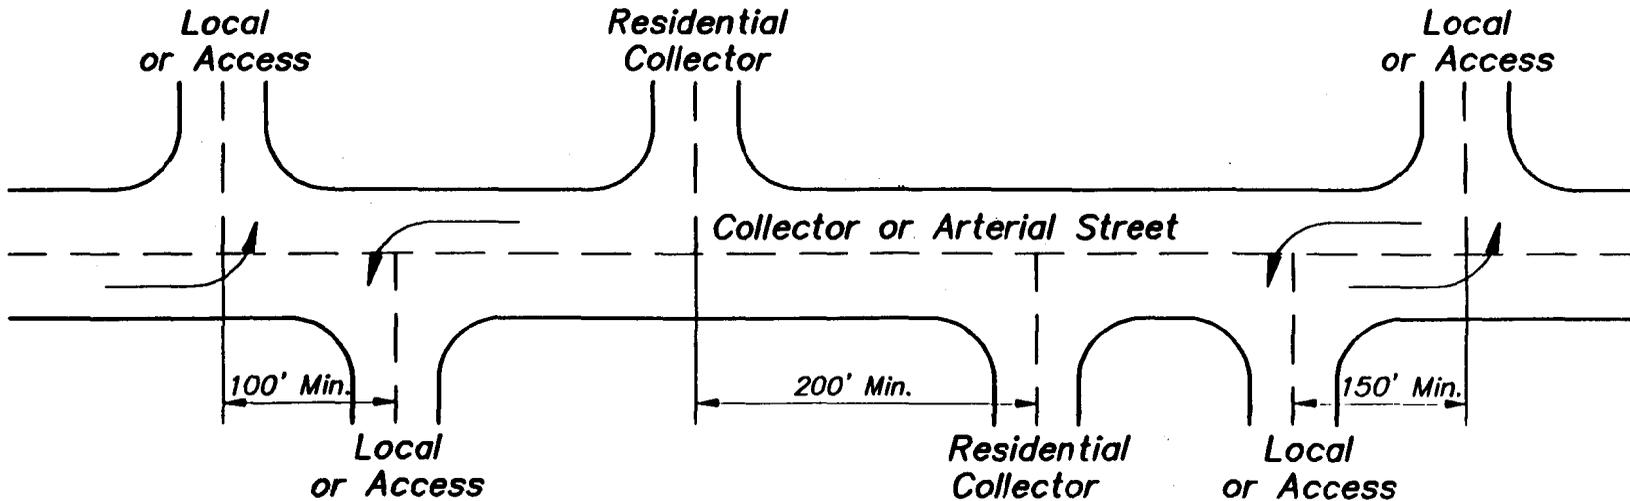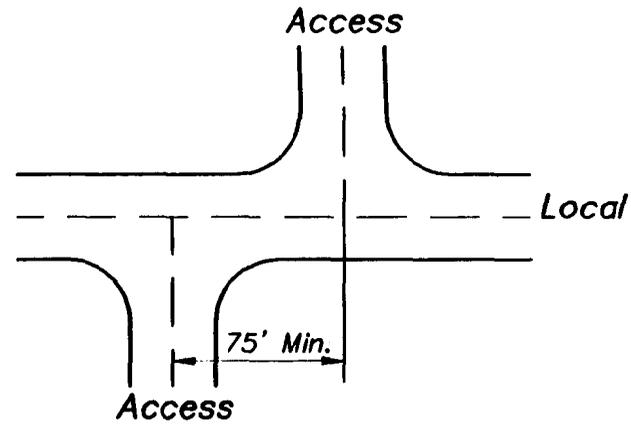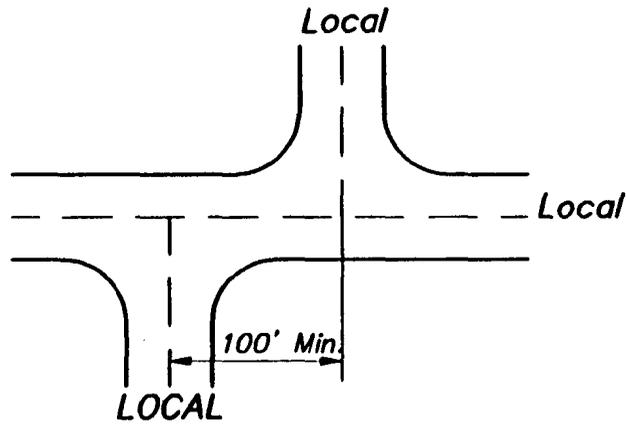

MINIMUM INTERSECTION SPACING

150' min. local street separation with no turning conflicts.

100' min. local street separation with no turning conflicts.

AMERICAN PUBLIC WORKS ASSOCIATION	
	KANSAS CITY METROPOLITAN CHAPTER
	STANDARD DRAWING NUMBER FIGURE 3 ADOPTED: APRIL 17, 1996
OFF-CENTER STREET INTERSECTIONS	




-  Access Street
-  Local Street
-  Collector Street

ARTERIAL STREET

TYPICAL RESIDENTIAL STREET LAYOUT

AMERICAN PUBLIC WORKS ASSOCIATION	
	KANSAS CITY METROPOLITAN CHAPTER
TYPICAL RESIDENTIAL STREET LAYOUT	STANDARD DRAWING NUMBER FIGURE 4 ADOPTED: APRIL 17, 1996

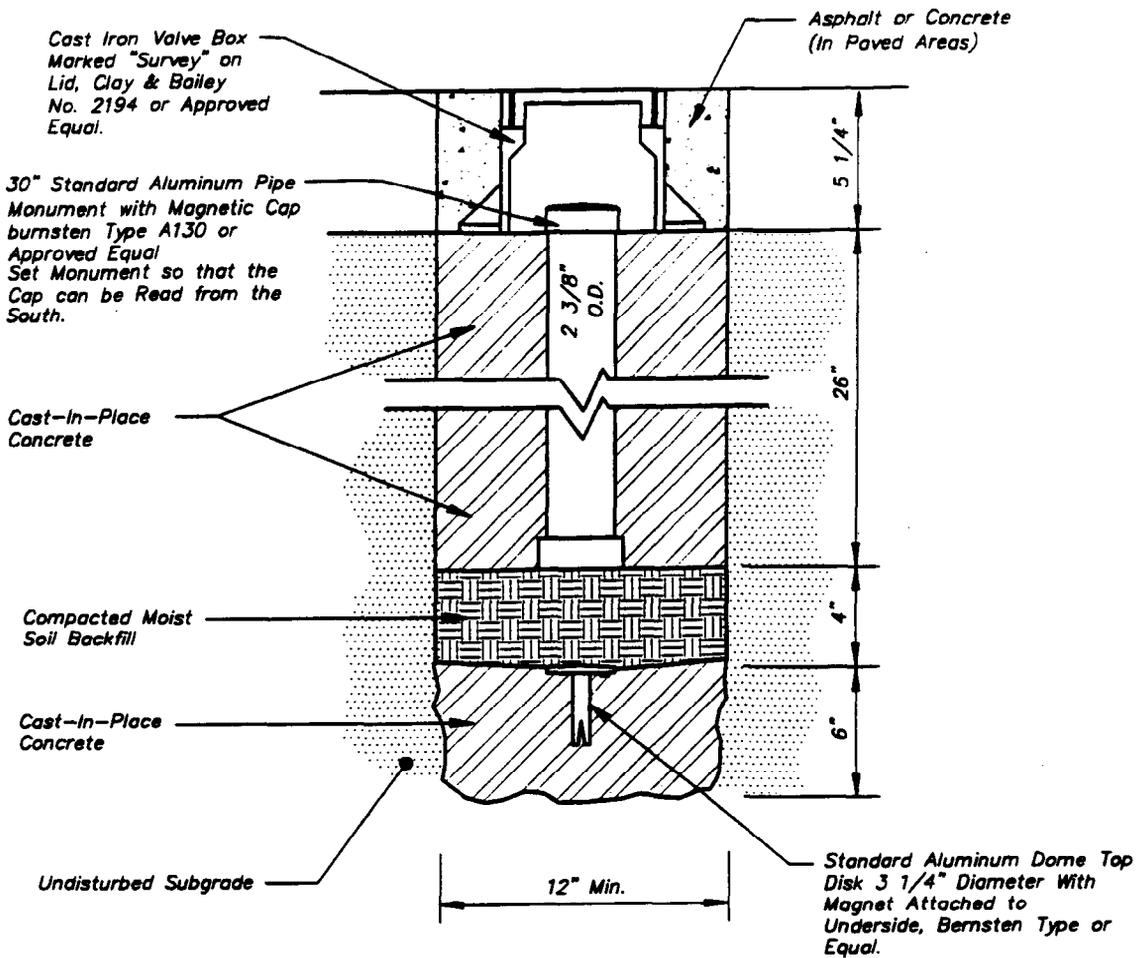

STANDARD LAND CORNER MONUMENT

(No Scale)

Note:

Disk marking for section corners shall comply with Missouri DNR Land Survey Division Standards of Practice 10CSR30-3.060 for monument markings in Missouri and with Kansas Society of Land Surveyors Standards of Practice #1 for monuments in Kansas.

AMERICAN PUBLIC WORKS ASSOCIATION



KANSAS CITY
METROPOLITAN CHAPTER

SURVEY
MONUMENT BOX

STANDARD DRAWING
NUMBER FIGURE SMB

ADOPTED:
APRIL 17, 1996

STREET CLASSIFICATION	PAVEMENT TYPES	
	OPTION 1	OPTION 2
Major Arterial	9" min. portland cement concrete pavement 6" min. compacted subgrade 95% of standard max. density	2" Type 3 asphaltic concrete surface 10" min. Type 1 asphaltic concrete base course 6" min. compacted subgrade 95% of standard max. density
Industrial Collector and Minor Arterial	8" min. portland cement concrete pavement 6" min. compacted subgrade 95% of standard max. density	2" Type 3 asphaltic concrete surface 9" min. Type 1 asphaltic concrete base course 6" min. compacted subgrade 95% of standard max. density
Commercial Collector	7" min. portland cement concrete pavement 6" min. compacted subgrade 95% of standard max. density	2" Type 3 asphaltic concrete surface 7" min. Type 1 asphaltic concrete base course 6" min. compacted subgrade 95% of standard max. density
Residential Access, Residential Local, and Residential Collector	6" min. portland cement concrete pavement 6" min. compacted subgrade 95% of standard max. density	2" Type 3 asphaltic concrete surface 6" min. Type 1 asphaltic concrete base course 6" min. compacted subgrade 95% of standard max. density

General Notes:

1. The pavement thicknesses shown are minimums and the actual pavement design thickness should be determined by an engineering analysis of the traffic and local subgrade conditions.
2. Other pavement type options to be considered shall be submitted to the local government for approval.

3. Concrete pavement joint detail shall be submitted to the local government for approval.

AMERICAN PUBLIC WORKS ASSOCIATION



KANSAS CITY
METROPOLITAN CHAPTER

STREET
PAVEMENT TYPES

STANDARD DRAWING
NUMBER TABLE 1

(ADD IF T)
APRIL 17, 1996